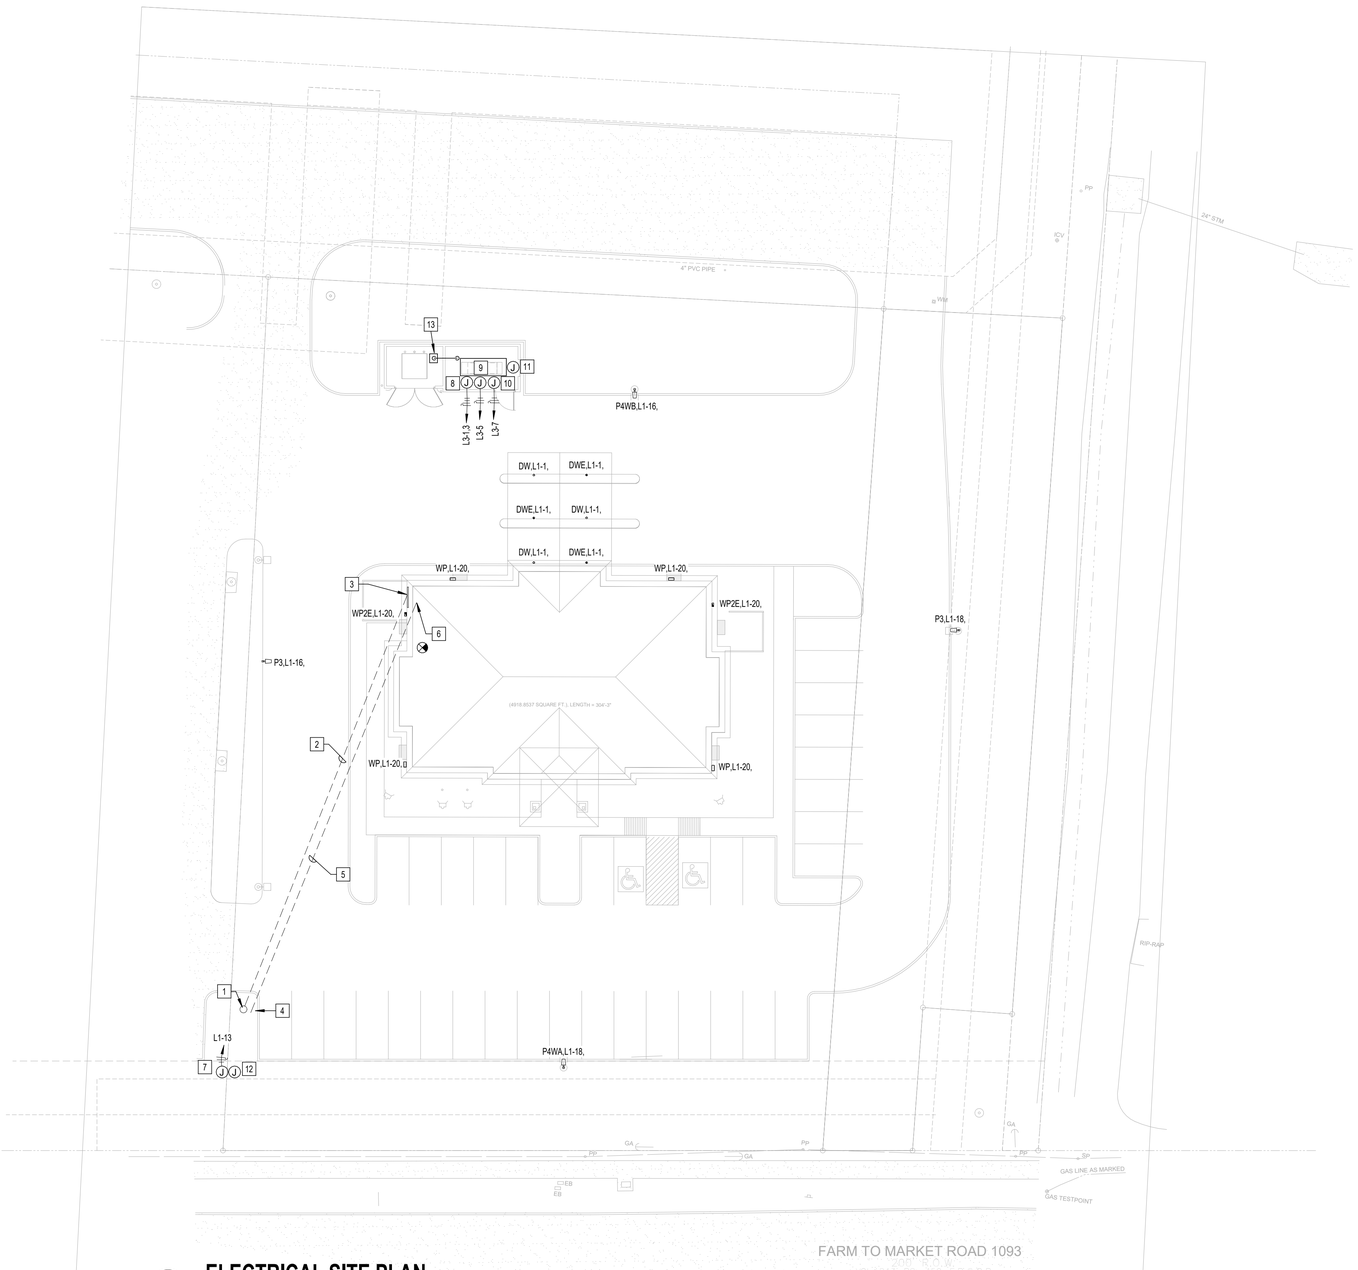


1 **ELECTRICAL SITE PLAN**
1" = 20'-0"

NOTE:
ALL ELECTRICAL DEVICE AND LIGHT FIXTURE LOCATIONS ARE APPROXIMATE. FOR EXACT LOCATION REFER TO ARCHITECTURAL DRAWINGS.

LOCATION OF ELECTRICAL SERVICE CONNECTION HAS NOT BEEN CONFIRMED. EXACT LOCATION MUST BE VERIFIED.

VERIFY EXACT LOCATION REQUIREMENTS WITH THE AUTHORIZED REPRESENTATIVE OF THE UTILITY COMPANY, AS FOLLOWS:

ELECTRICAL: CENTER POINT ENERGY

## MEP KEYED NOTE

| # | KEYNOTE |
|---|---|
| 1 | POPOSED LOCATION OF UTILITY COMPANY TRANSFORMER POLE. COORDINATE EXACT LOCATION IN FIELD. |
| 2 | PROPOSED LOCATION OF UNDERGROUND FEEDERS. COORDINATE EXACT LOCATION IN FIELD. |
| 3 | PROPOSED LOCATION OF ELECTRICAL SERVICE ENTRANCE LOCATION. COORDINATE EXACT LOCATION IN FIELD. |
| 4 | COORDINATE EXACT TERMINATION/REQUIREMENTS IN FIELD. |
| 5 | PROPOSED 2 - 4" UNDERGROUND COUDIT WITH PULL WIRE. COORDINATE EXACT LOCATION IN FIELD. |
| 6 | TO DATA ROOM. COORDINATE EXACT LOCATION IN FIELD. |
| 7 | JUNCTION BOX FOR SIGN. COORDINATE EXACT LOCATION IN FIELD. |
| 8 | JUNCTION BOX FOR ANTI-CONDENSATION HEATER. COORDINATE EXACT REQUIREMENTS IN FIELD. |
| 9 | JUNCTION BOX FOR BATTERY CHARGER. COORDINATE EXACT REQUIREMENTS IN FIELD. |
| 10 | JUNCTION BOX FOR JACKET HEATER. COORDINATE EXACT REQUIREMENTS IN FIELD. |
| 11 | 2 - 1" CONDUIT WITH PULL WIRE BACK TO ELECTRICAL ROOM. COORDINATE EXACT REQUIREMENTS IN FIELD. |
| 12 | 1 - 1" CONDUIT WITH PULL WIRE BACK TO ELECTRICAL ROOM. COORDINATE EXACT REQUIREMENTS IN FIELD. |
| 13 | PROPOSED GAS MATER LOCATION. PROVIDE 2" GAS LINE, 20'-0" TOTAL DEVELOPED LENGTH FROM METER TO GAS CONNECTION AT GENERATOR, 1066 CFH. |

SLI DESIGN, INC.
ARCHITECTURE PLANNING INTERIOR DESIGN
15810 PARK TEN PLACE, SUITE 300
HOUSTON, TEXAS 77084
713-465-4650
www.sligroup.com
© COPYRIGHT

Shell Federal CREDIT UNION
26620 FM 1093 RD
KATY, TEXAS 77494

Project Number : 8925

| | DATE |
|---|---|
| ISSUED FOR CLIENT APPROVAL | |
| ISSUED FOR BIDDING | |
| ISSUED FOR PERMIT | |
| ISSUED FOR CONSTRUCTION | |

**REVISIONS**

| MARK | DESCRIPTION | DATE |
|---|---|---|
| | ISSUE FOR BID | 04/07/2026 |

The information, ideas, designs, details, layouts, techniques, features, arrangements, plans, sequences, dimensions, allowances, tolerances, conceptions, specifications, intentions, technology or embodiments, as illustrated, arranged, displayed, noted, recorded, indicated, represented, disclosed, evidenced, detailed or otherwise reduced to tangible form hereon, either expressly, inherently or by implication, are the confidential and proprietary information of SLI Design, Inc., and shall not be used for any purpose other than the specific project or undertaking identified on the drawing title block or legend for which they are and have been prepared by SLI Design, Inc. Any other reproduction, disclosure or use of any portion of the confidential and proprietary information of SLI Design, Inc., shall be a breach of the obligation of confidence created by the acceptance of this drawing from SLI Design, Inc. for a specific project or Contract. Any copying, duplicating, reproducing, utilization, alteration, modification, revision or change to this drawing, is expressly prohibited unless done with the prior written consent or approval of SLI Design, Inc., and shall not be undertaken without receipt of such prior written approval. This drawing is loaned by SLI Design, Inc., for the limited purpose of complying with a specific Contract. The drawing remains the property of SLI Design, Inc., and shall be returned upon request or completion of the contract, unless specifically authorized by Contract, under which it was loaned.

PRINT DATE: 4/6/2026 3:44:19 PM

STATE OF TEXAS
N. CURTIS JONES, JR.
58428
REGISTERED
PROFESSIONAL ENGINEER

JE#5126
04/07/2026
THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY N. CURTIS JONES, JR. P.E. 58428

JONES ENGINEERS, L.P.
Consulting Mechanical/Electrical/Plumbing Engineers
9820 Whithorn Dr. Houston, Texas 77095 (713)222-7766
Texas Registered Engineering Firm #F-3811

DRAWING TITLE
**MEP SITE PLAN**

| | | |
|---|---|---|
| DRAWN BY | JE | SHEET NO. |
| CHECKED BY | JE | MEP0.01 |
| APPROVED BY | JE | |

Autodesk Docs://5126 - SFCU Fulshear/5126_MEP_SFCU_Fulshear_R26.rvt