GENERAL NOTES:

A. ALL CIRCUIT NUMBERS SHOWN FOR LOCATION AND QUANTITY ONLY. VERIFY EXACT NUMBERS IN FIELD. UTILIZE ALL CIRCUITS MADE AVAILABLE BY DEMOLITION PLUS ALL AVAILABLE SPACES AND 1P/20A SPARES TO COMPLETE LAYOUT AS SHOWN. UPDATE PANEL SCHEDULES WHEN WORK IS COMPLETED.

B. THE FIRE ALARM DESIGN, ENGINEERING, DESIGN APPROVAL, INSTALLATION AND FINAL ACCEPTANCE BY THE AUTHORITIES HAVING JURISDICTION IS THE SOLE RESPONSIBILITY OF THE FIRE ALARM CONTRACTOR. DEVICES AND EQUIPMENT INDICATED ON THE DRAWINGS ARE DESIGN INTENT ONLY. FINAL DEVICE TYPES, QUANTITIES AND LOCATIONS ARE THE RESPONSIBILITY OF THE FIRE ALARM CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL COORDINATE REQUIREMENTS WITH THE FIRE ALARM CONTRACTOR AND PROVIDE ROUGH-IN AND POWER FOR ALL DEVICES PER THE APPROVED FIRE ALARM PLANS.

C. PROVIDE ELECTRICAL CONNECTION TO VAV BOXES AND CONTROLLERS AS REQUIRED. COORDINATE EXACT REQUIREMENTS WITH MECHANICAL AND CONTROLS CONTRACTOR. USE AVAILABLE 120V, 20A CIRCUIT.

D. ALL RECEPTACLE CONTROLS SHALL BE PROVIDED TO MEET THE REQUIREMENTS OF 2021 IECC. FOR NEW RECEPTACLES, PRICE TO PROVIDE SPLIT CONTROLLED RECEPTACLES CONTROLLED BY OCCUPANCY/ VACANCY SENSOR IN EACH ROOM INDICATED: ENCLOSED OFFICES, CONFERENCE ROOMS, ROOMS USED PRIMARILY FOR COPY OR PRINT FUNCTIONS, BREAKROOMS, AND CLASSROOMS. FOR NEW WORKSTATION POWER, PRICE TO PROVIDE HALF OF CIRCUITS FOR INDIVIDUAL WORKSTATIONS TO BE CONTROLLED BY OCCUPANCY/ VACANCY SENSOR. REFER TO DETAIL SHEET FOR FURTHER INFORMATION. IF TIMECLOCK IS PREFERRED CONTACT EOR FOR RELAY PANEL REQUIREMENTS. STANDALONE PRINTERS/COPIERS, DISHWASHERS, FRIDGES, ICE MAKERS, COFFEE MAKERS, MICROWAVES AND SIMILAR DEDICATED PIECES OF EQUIPMENT AS DESIGNATED ON ARCHITECT'S PLANS ARE NOT REQUIRED TO BE CONTROLLED (24/7 OPERATION). DO NOT PROVIDE POWERPACKS FOR ANY OF THIS EQUIPMENT.

E. CONTRACTOR TO PROVIDE GFCI CIRCUIT BREAKER OR REMOTE RESET BUTTON FOR ALL CIRCUITS WITH INACCESSIBLE RECEPTACLES CONCEALED BEHIND APPLIANCES OR WITHIN 6'-0" FROM WATER SOURCE. COORDINATE EXACT LOCATIONS AND QUANTITIES WITH ARCHITECT/OWNER PRIOR TO ROUGH-IN.

F. CONTRACTOR TO VERIFY WITH FURNITURE SYSTEM MANUFACTURER THAT FURNITURE IS AN EIGHT WIRE FOUR CIRCUIT SYSTEM AS SHOWN PRIOR TO ROUTING CIRCUITRY TO J-BOXES. IF CONFIGURATION IS OTHERWISE, CONTACT ENGINEER FOR RECIRCUITING.

G. CONTRACTOR TO PROVIDE (1) COMPUTER CIRCUIT AND (1) GENERAL PURPOSE CIRCUIT AT FURNITURE FEED AS SHOWN. JUMPER CONNECTIONS AT BASE FEED AS NECESSARY TO PROVIDE POWER TO ALL RECEPTACLES IN FURNITURE CLUSTER.

NOTES BY SYMBOL:

(1) PROVIDE POWER FOR FLOOD STOP LEAK DETECTION SYSTEM. COORDINATE EXACT LOCATION WITH PLUMBING.

(2) CONTRACTOR TO CONNECT RECEPTACLE TO EXISTING RECEPTACLE CIRCUIT AS SHOWN. VERIFY MAXIMUM OF 16A ON CIRCUIT AFTER ADDITION OF RECEPTACLE.

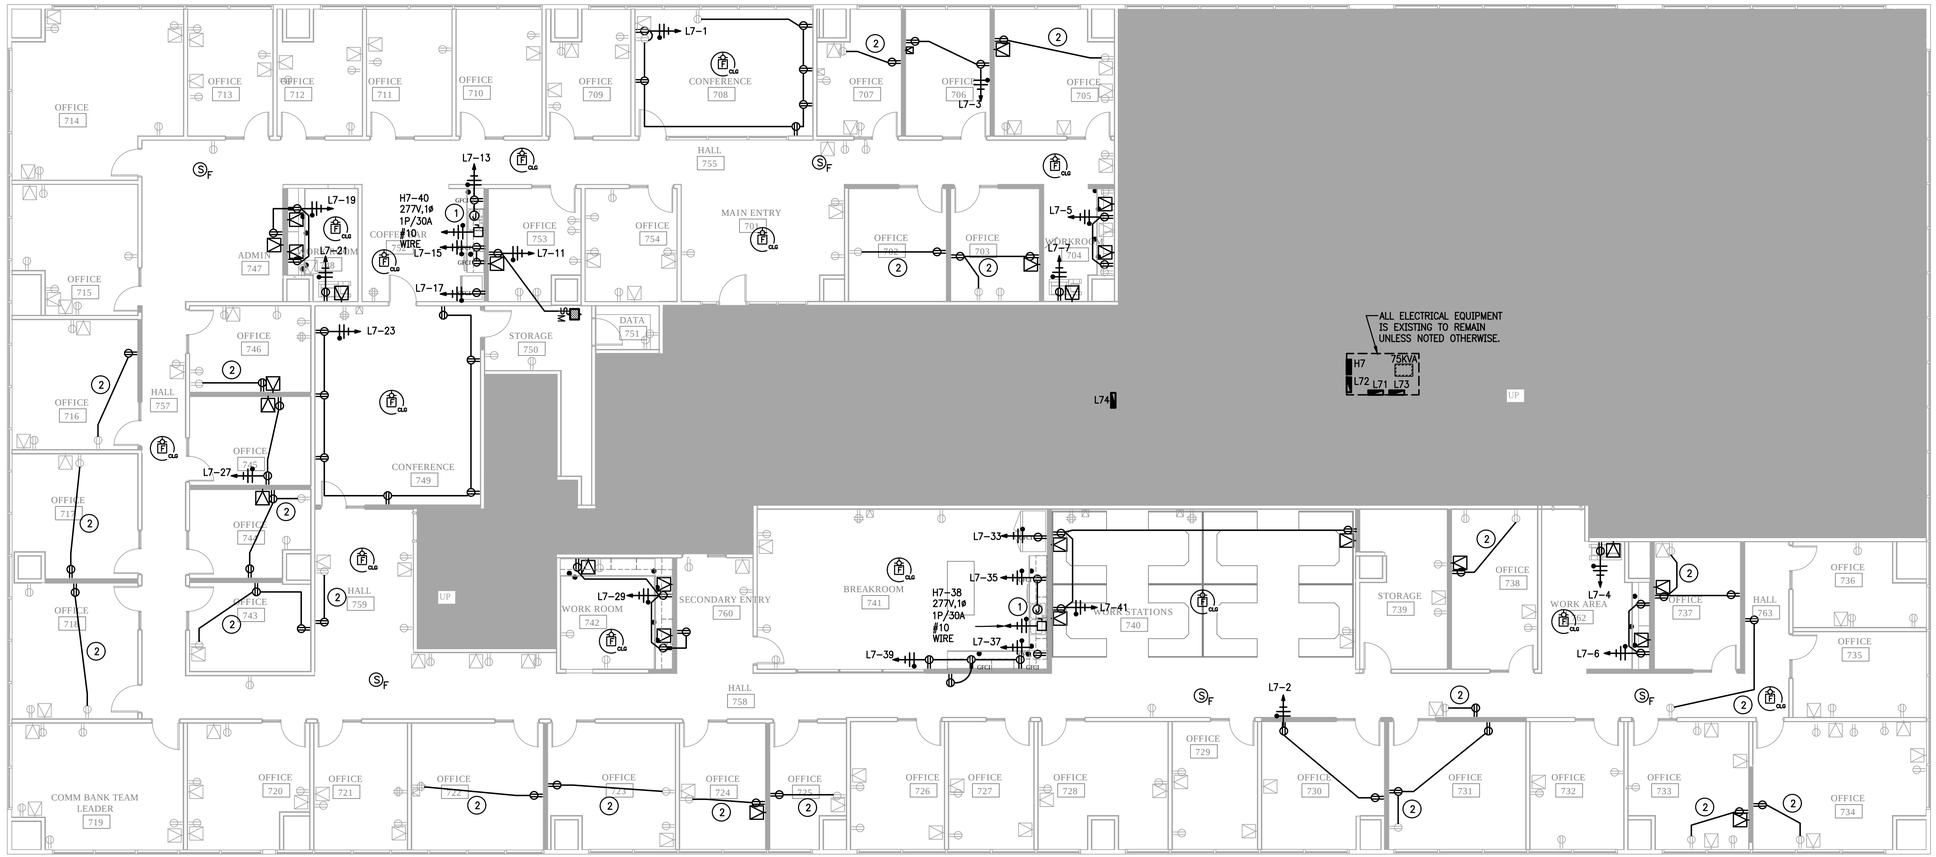

1 7TH LEVEL FLOOR PLAN - ELECTRICAL
SCALE: 1/8"=1'-0"

0 4' 8' 16' 24'
SCALE: 1/8"=1'-0"

SLI GROUP, INC.
ARCHITECTURE | DESIGN | CONSTRUCTION
15810 PARK TEN PLACE, SUITE 300
HOUSTON, TEXAS 77084
713-465-4650
www.sligroup.com

© COPYRIGHT

PROSPERITY BANK®

PROSPERITY BANK - RENOVATION
5949 SHERRY LANE
7TH FLOOR
DALLAS, TEXAS 75225

Project Number : 25-8974-01

ISSUED FOR	DATE
ISSUED FOR CLIENT APPROVAL	
ISSUED FOR BIDDING	
ISSUED FOR PERMIT	02/23/2026
ISSUED FOR CONSTRUCTION	

REVISIONS

MARK	DESCRIPTION	DATE

The information, ideas, designs, details, layouts, techniques, features, arrangements, plans, sequences, dimensions, allowances, tolerances, conceptions, specifications, intentions, technology or embodiments, as illustrated, arranged, displayed, noted, recorded, indicated, represented, disclosed, evidenced, detailed or otherwise reduced to tangible form hereon, either expressly, inherently or by implication, are the confidential and proprietary information of SLI Design, Inc., and shall not be used for any purpose other than the specific project or undertaking identified on the drawing title block or legend for which they are and have been prepared by SLI Design, Inc. Any other reproduction, disclosure or use of any portion of the confidential and proprietary information of SLI Design, Inc., shall be a breach of the obligation of confidence created by the acceptance of this drawing from SLI Design, Inc. for a specific project or Contract. Any copying, duplicating, reproducing, utilization, alteration, modification, revision or change to this drawing, is expressly prohibited unless done with the prior written consent or approval of SLI Design, Inc., and shall not be undertaken without receipt of such prior written approval. This drawing is loaned by SLI Design, Inc., for the limited purpose of complying with a specific Contract. The drawing remains the property of SLI Design, Inc., and shall be returned upon request or completion of the contract, unless specifically authorized by Contract, under which it was loaned.

PRINT DATE: 02/23/2026

STATE OF TEXAS
MATTHEW E. DEEKE
104941
LICENSED PROFESSIONAL ENGINEER
02/23/2026

DRAWING TITLE: 7TH LEVEL FLOOR PLAN - ELECTRICAL

DRAWN BY: Author
CHECKED BY:
APPROVED BY:

SHEET NO. E2.07

SCHMIDT & STACY CONSULTING ENGINEERS, INC.
2900 CITYPLACE
2711 N. HASKELL AVE.
DALLAS, TEXAS 75204
214-874-0200
TEXAS REGISTRATION #F000521
PROJECT # 1809083