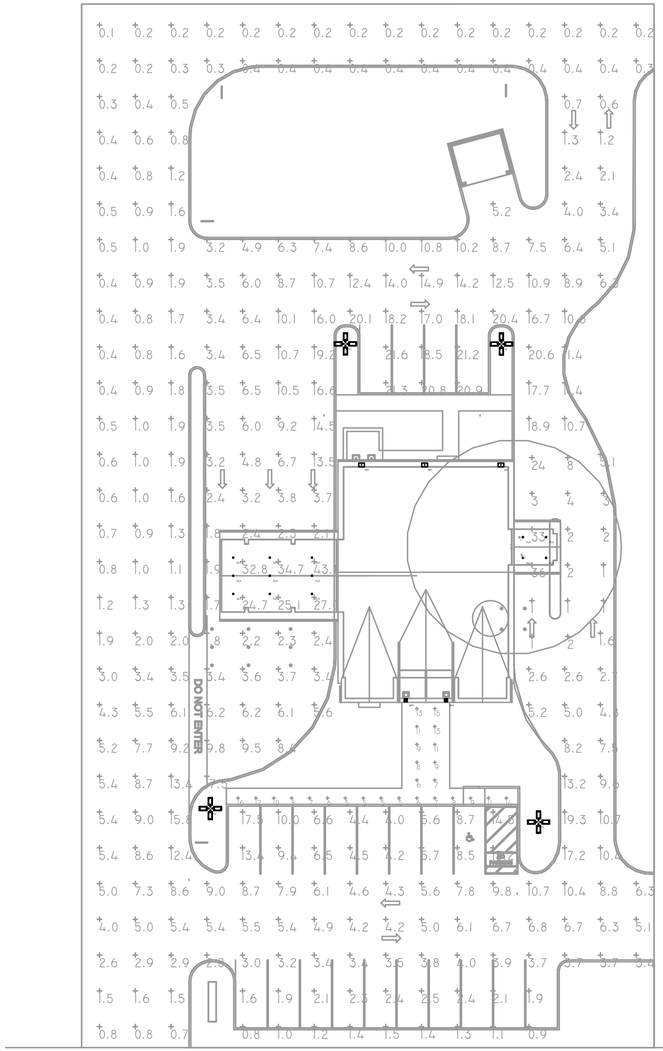


Luminaire Schedule								
Symbol	Qty	Label	Mounting Height	Description	LLF	Luminaire Lumens	Luminaire Watts	Total Watts
	13	D4X	10, 10.5	WILLIAMS P/N: 4DR-TL-L20/835-DIM-UNV-OW-OF-CS-WET-CC-N-F1	0.900	1704	20	260
	4	SL	22	LSI P/N: MRM-LED-18L-SIL-FT-UNV-DIM-30-70CRI-XX	0.850	19324	135	2160
	3	WM	10	LSI P/N: XWM-4-LED-12L-40-UE-XX	0.900	12058	77	231
	2	WM1	7.5	PEMCO P/N: PMCARL3WMSET	0.900	3801	30.6	61.2

Calculation Summary								
Label	CalcType	Grid Z	Units	Avg	Max	Min	Avg/Min	Max/Min
ATM FACE_Side_2	Illuminance	2.405 to 5.082	Fc	9.83	15	5	1.97	3.00
CALCS @ GRADE	Illuminance	3	Fc	5.88	43.1	0.1	58.80	431.00
CALCS 5' FROM ATM FACE	Illuminance	3	Fc	31.50	32	31	1.02	1.03
CALCS 60' FROM ATM FACE	Illuminance	3	Fc	7.75	36	1	7.75	36.00
SIDEWALK CALCS	Illuminance	0.5	Fc	9.08	16	5	1.82	3.20

N

EBE CONSULTING ENGINEERS Mechanical Electrical Plumbing
12603 Southwest Frwy, Ste 170, Stafford, Tx 77477
Tel: (713) 840-0177 / Firm Reg. No: 5638

SLI GROUP, INC.
ARCHITECTURE | DESIGN | CONSTRUCTION
15810 PARK TEN PLACE, SUITE 300
HOUSTON, TEXAS 77084
713-465-4650
www.sligroup.com

© COPYRIGHT

National Bank & Trust

National Bank & Trust - Bastrop

Enter address here

E/BE Project Number : 26129.00

	DATE
ISSUED FOR CLIENT APPROVAL	
ISSUED FOR BIDDING	09/11/26
ISSUED FOR PERMIT	09/11/26
ISSUED FOR CONSTRUCTION	11/02/26

REVISIONS

MARK	DESCRIPTION	DATE
	70% REVIEW SET	07/29/26
	90% REVIEW SET	08/20/26
	ISSUE FOR PERMIT & BID	09/11/26
	ADDENDUM A	09/18/26
	ADDENDUM B	09/24/26
	ADDENDUM C	10/07/26
	ADDENDUM F	10/30/26
	ISSUE FOR CONSTRUCTION	11/02/26

The information, ideas, designs, details, layouts, techniques, features, arrangements, plans, sequences, dimensions, allowances, tolerances, conceptions, specifications, intentions, technology or embodiments, as illustrated, arranged, displayed, noted, recorded, indicated, represented, disclosed, evidenced, detailed or otherwise reduced to tangible form hereon, either expressly, inherently or by implication, are the confidential and proprietary information of SLI Design, Inc., and shall not be used for any purpose other than the specific project or undertaking identified on the drawing title block or legend for which they are and have been prepared by SLI Design, Inc. Any other reproduction, disclosure or use of any portion of the confidential and proprietary information of SLI Design, Inc., shall be a breach of the obligation of confidence created by the acceptance of this drawing from SLI Design, Inc. for a specific project or Contract. Any copying, duplicating, reproducing, utilization, alteration, modification, revision or change to this drawing, is expressly prohibited unless done with the prior written consent or approval of SLI Design, Inc., and shall not be undertaken without receipt of such prior written approval. This drawing is loaned by SLI Design, Inc., for the limited purpose of complying with a specific Contract. The drawing remains the property of SLI Design, Inc., and shall be returned upon request or completion of the contract, unless specifically authorized by Contract, under which it was loaned.

STATE OF TEXAS
JOSE M. GUERRERO
154536
REGISTERED PROFESSIONAL ENGINEER
11/02/2026

DRAWING TITLE
EXTERIOR LIGHTING PHOTOMETRICS

SHEET NO.
E8.10